


STANDARD SIDEWALK WIDTHS

Sidewalk widths for sidewalks in districts described in the Comprehensive Zoning Code for the City and County of Honolulu shall conform to the following:

District	Paved Sidewalk Width
All Residential	4 feet minimum
A-1, A-2, and A-3 Apartment	4 feet minimum
A-4 and A-5 Apartment	6 feet minimum
H-1 Resort Hotel	4 feet minimum; required width for each location shall be determined by the Chief Engineer.
H-2 Hotel	Full width unless determined otherwise by the Chief Engineer.
B-1 Business	4 feet minimum
B-2, B-3, and B-5 Business	6 feet minimum
B-4 Business	Full width
All Industrial	4 feet minimum
All Planned Development (For streets to be dedicated to the City.)	4 feet minimum

SIDEWALK WITH STANDARD CURB & GUTTER

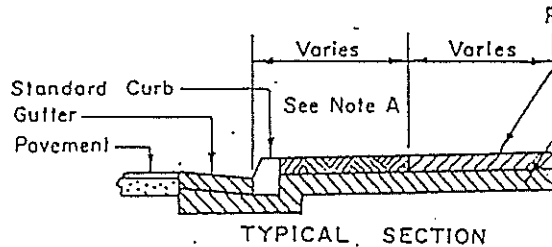

4" Class B concrete broom finish perpendicular to curb. Standard slope 1/4" per L.F. Chief Engineer may authorize different slope to suit special conditions.

6" select borrow under sidewalk, curb and gutter wherever expansion value of subgrade exceeds 3%.


All utility installations shall be identified with the name of the utility company on the frame or cover. Checkered metal covers installed in sidewalks with slopes exceeding 10% shall be painted with non-skid paint.

Where concrete curb or sidewalk exists or is to be constructed, driveways shall be of concrete.

NOTE A:

- Full-width concrete sidewalks may be permitted when constructed for the entire block.
- Lawn grass or vegetative ground cover of a type with a maximum growth height of 4" or of a type that will grow to a trimmed height of 4" except vines or other planting which may be a tripping hazard. 4" topsoil required.
- In lieu of lawn grass the Chief Engineer may authorize:
 - Acceptable artificial turf, with proper bases,
 - Precast masonry units laid closely in a uniform pattern (bricks, tile caps, etc.) with proper base,
 - Asphalt concrete on proper base,
 - Concrete poured separately from the concrete sidewalk, and of similar thickness, and
 - Loose aggregates, such as basaltic, coral or limestone chips.
- Street trees including existing trees may be permitted in sidewalk areas subject to the approval of the Department of Parks and Recreation.
- Sprinklers, set flush with the surface, may be permitted by the Chief Engineer.
- In areas where curbs exist with unpaved sidewalks, temporary asphalt concrete walkways may be installed, if authorized by the Chief Engineer.
- Deviation from this standard and other sidewalk standards may be permitted upon written approval of the Chief Engineer.

SIDEWALK AREA WITHOUT CURB OR GUTTER

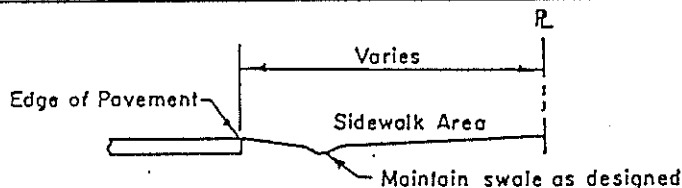

GENERAL NOTE:

Mailbox support shall be of a type which causes minimal obstruction to traffic.